

REVISION		DATE		No.	SDJ-315007 & -70
LAPP INSULATOR COMPANY LABOY, N. Y. 14468		TITLE STATION POST ASSEMBLY			
UNITS in. (mm)		ORG. DATE 10-25-95		DWN. <i>J. Verano</i>	
REF. TECHNICAL REFERENCE No. TR-7		APP.			

ASSEMBLY NO.	GLAZE COLOR
J-315007	CHOCOLATE
J-315007-70	LIGHT GRAY No.70

DIMENSIONS

LEAKAGE DISTANCE, in. 20

MECHANICAL VALUES

CANTILEVER STRENGTH, lb. 2000
 TENSION STRENGTH, lb. 5000
 TORSION STRENGTH, in-lb. 8000
 COMPRESSION STRENGTH, lb. 10000

ELECTRICAL VALUES


CRITICAL IMPULSE FLASHOVER, POS., kV. 170
 LOW FREQUENCY WET WITHSTAND, kV. 60
 IMPULSE WITHSTAND, kV. 150

RADIO INFLUENCE VOLTAGE DATA

TEST VOLTAGE RMS TO GROUND, kV 15
 MAXIMUM RIV, MICROVOLTS AT 1000 kHz 100

NOTES:

1. DIMENSIONS ARE IN INCHES (MILLIMETERS)
2. ALL FERROUS PARTS ARE HOT DIP GALV. PER ASTM A153
3. UNIT PART NUMBER STAMPED ON TOP HARDWARE

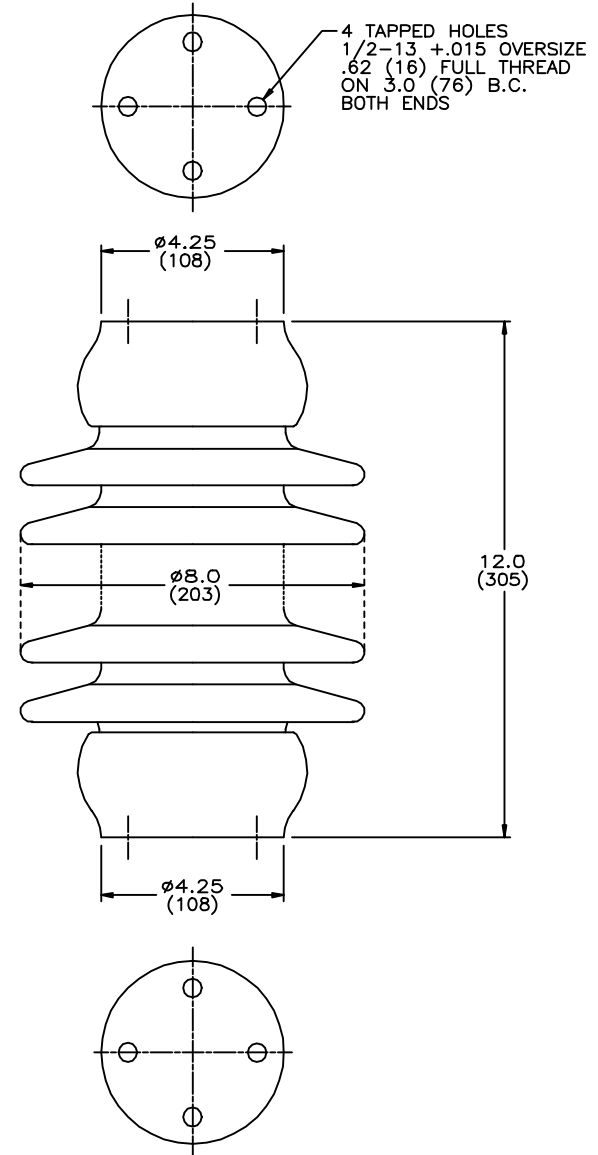

NOTE TO PURCHASER
 ALL SALES OF LAPP PRODUCTS ARE
 SUBJECT TO OUR STANDARD TERMS
 AND CONDITIONS AND THE LIMITED
 WARRANTIES THEREUNDER.