

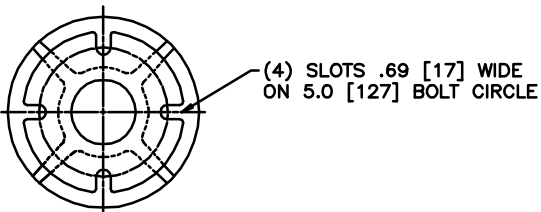
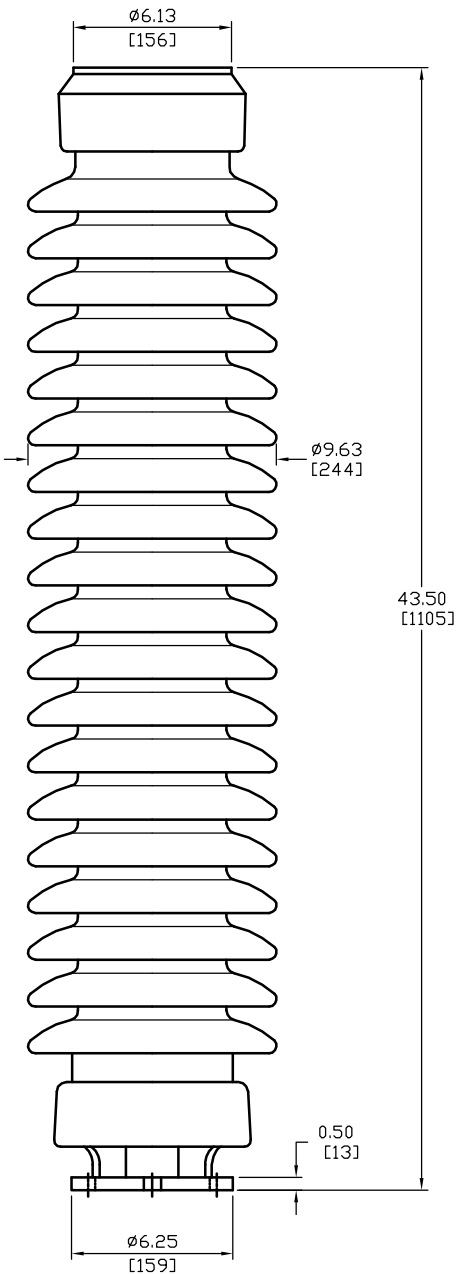


REVISION HISTORY	DATE
DRAWING / DESIGN CREATED	01-30-95
REVISED PORCELAIN	02-03-03 JRC

LAPP
INSULATOR COMPANY
 LEROY, N.Y. 14482
 (58) 768-6221
SUBSTATION DIVISION
 REF. TR-19

 in. [mm]	BASE PART NUMBER 317019 (SERIES) (SEE TABLE FOR VERSIONS)
TITLE	PEDESTAL POST

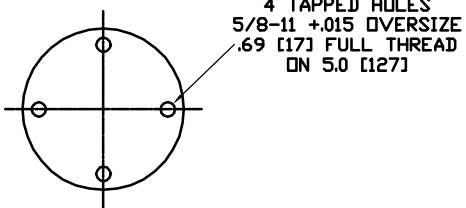

DIMENSIONS		
LEAKAGE DISTANCE, IN. (mm)	99	(2515)
MECHANICAL VALUES		
CANTILEVER STRENGTH, lb. (kN)	1700	(7.6)
TENSION STRENGTH, lb. (kN)	20000	(88.9)
TORSION STRENGTH, in-lb. (kNm)	40000	(4.5)
COMPRESSION STRENGTH, lb. (kN)	60000	(266.9)
ELECTRICAL VALUES		
CRITICAL IMPULSE FLASHOVER, POS., kV.	610	
LOW FREQUENCY WET WITHSTAND, kV.	230	
IMPULSE WITHSTAND, kV.	550	

- NOTES:**
1. DIMENSIONS ARE IN INCHES [MILLIMETERS]
 2. ALL FERROUS PARTS ARE HOT DIP GALV. PER ASTM A153

ASSEMBLY	GLAZE COLOR
J-317019	CHOCOLATE
J-317019-70	LIGHT GRAY No.70

NOTE TO PURCHASER
 ALL SALES OF LAPP PRODUCTS ARE
 SUBJECT TO OUR STANDARD TERMS
 AND CONDITIONS AND THE LIMITED
 WARRANTIES THEREUNDER.